
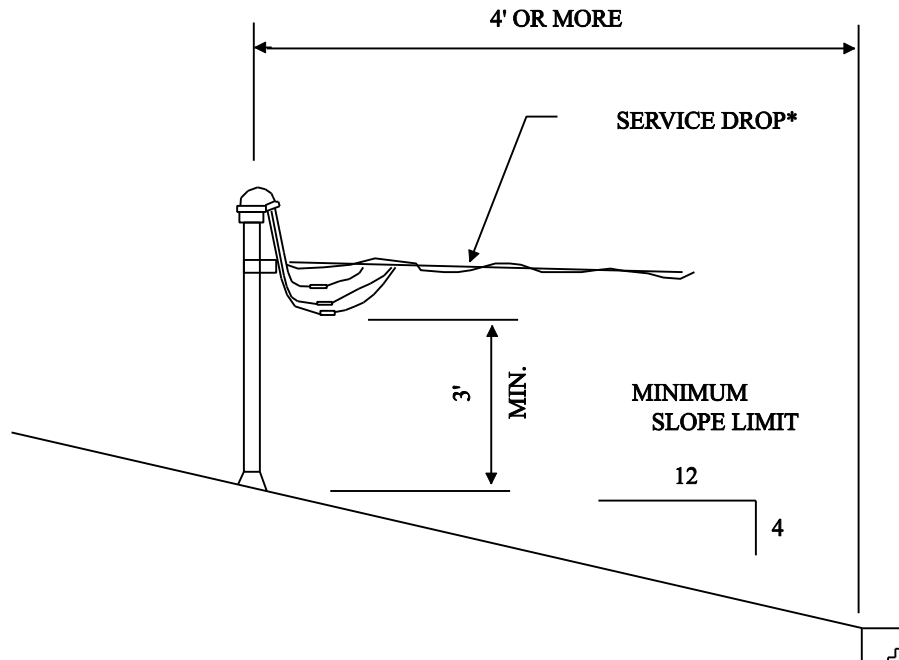


**SERVICE ATTACHMENTS OVER ROOFS**  
**FIGURE 4A**

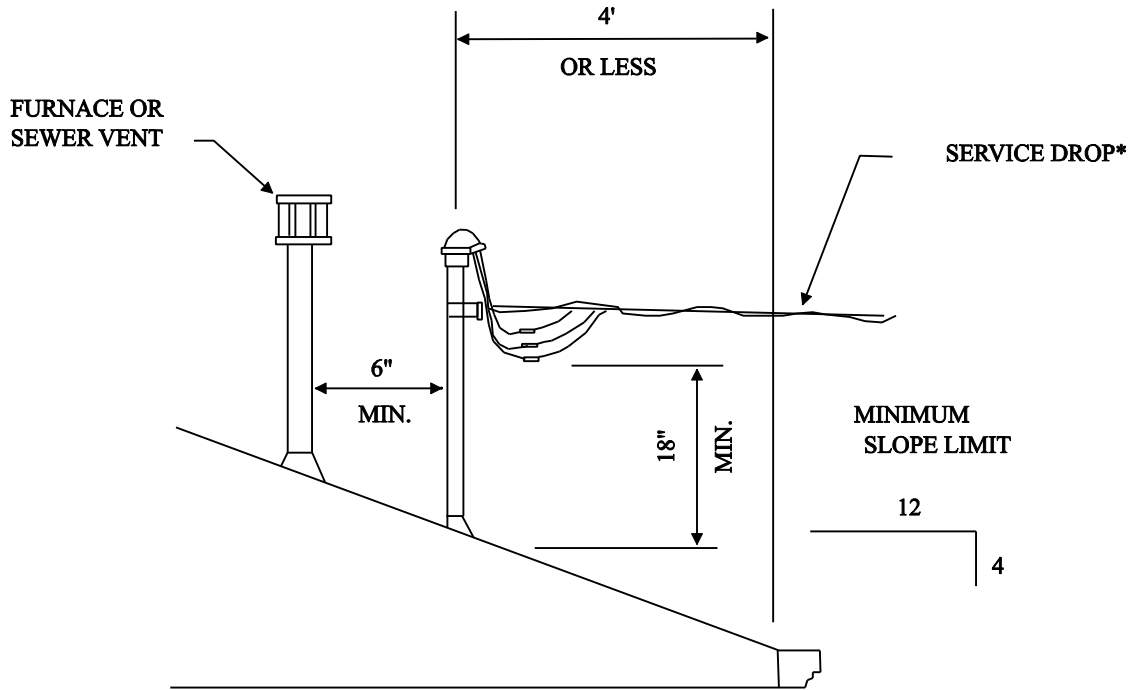

**NOTES:**

- \* 1. Supplied and installed by the utility.
- 2. Customer's service entrance conductors to extend 36" minimum out of weatherhead.