


---

**SERVICE OVER ROOFS**  
**FIGURE 4B**

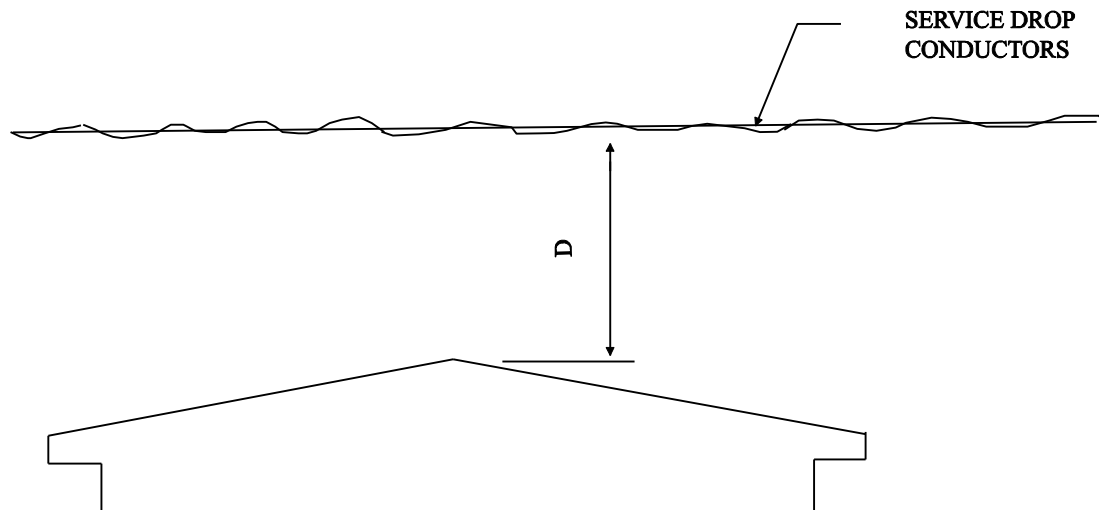

**NOTES:**

1. **CONDITIONS**
  - a. For roof slopes equal to or more than 4" in 12" D will be a minimum of 3'.
  - b. For roof slopes less than 4" in 12" D will be a minimum of 8'.
2. This vertical dimension applies to any point on the roof surface directly under the conductors.