


MINIMUM CLEARANCE FOR SERVICES
FIGURE 3B

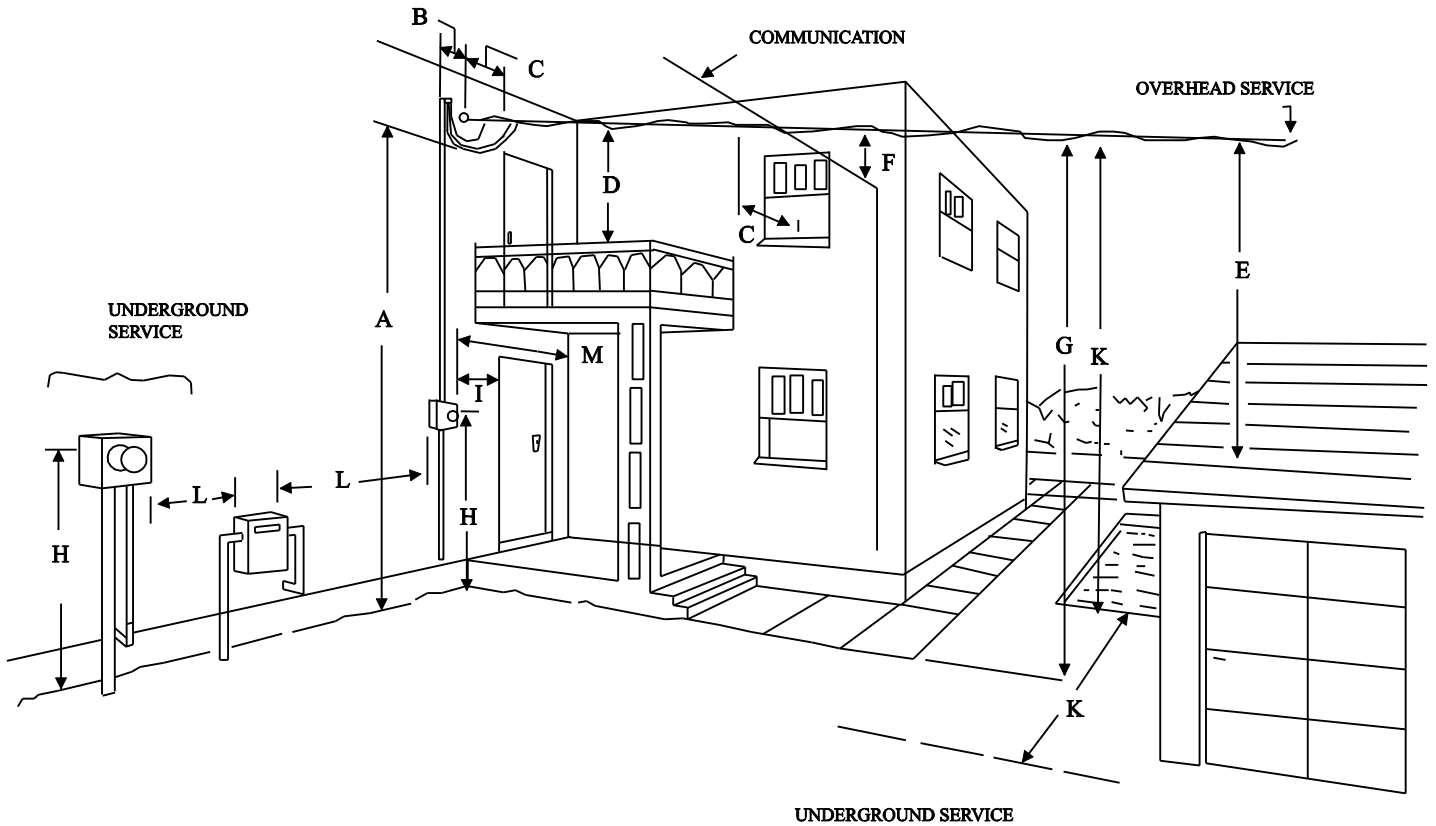

GENERAL NOTES:

1. The service weatherhead is to be located no lower than the service attachment point to insure a positive drip loop.
2. Contact your Company representative for entrance and meter location. The Company will refuse connection to any service entrance not installed in an approved location.
3. The customer shall install a suitable service attachment point to obtain proper ground clearance.
4. Service entrance conductors must be in conduit.